


## STRUCTURAL SECTION FOR WALKS

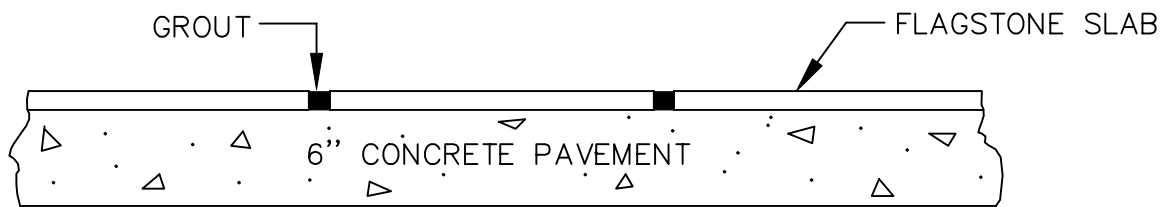

## STRUCTURAL SECTION AT DRIVEWAYS

### NOTES:

1. FLAGSTONE SLAB ON CONCRETE SHALL BE SET ON A 1 INCH (APPROX) MORTAR BED.
2. MINIMUM THICKNESS OF FLAGSTONE SHALL BE 2 INCHES.
3. LONGITUDINAL JOINTS ARE NOT ALLOWED IN FLAGSTONE SIDEWALKS SET ON COMPACTED SUBGRADE OR SAND BED. THE MINIMUM SIZED SLAB SHALL BE 4 FEET IN WIDTH AND 2 FEET LONG. RANDOMLY PLACED PIECES ARE NOT ALLOWED. THE MINIMUM SIZE PIECE ON CONCRETE BASE IS 2 FEET BY 2 FEET.
4. FLAGSTONE SLABS SHALL BUTT UP AGAINST ONE ANOTHER. A 1/2 INCH MAXIMUM GAP BETWEEN STONES IS ALLOWED ON WALKS. A SAND MORTAR MIX SHALL BE SWEEPED DRY BETWEEN OPEN CRACKS, THEN WETTED DOWN.
5. NO MORE THAN 1/4 INCH VERTICAL DISPLACEMENT BETWEEN FLAGSTONE SLABS.

DRAWN BY: JSH  
CHECKED BY: RJH

APPROVED BY:  
DIRECTOR OF PUBLIC WORKS

CITY OF BOULDER, COLORADO

FLAGSTONE WALK

ISSUED: JULY 2, 1998  
REVISED: OCT. 17, 2000

DRAWING NO.

2.05